

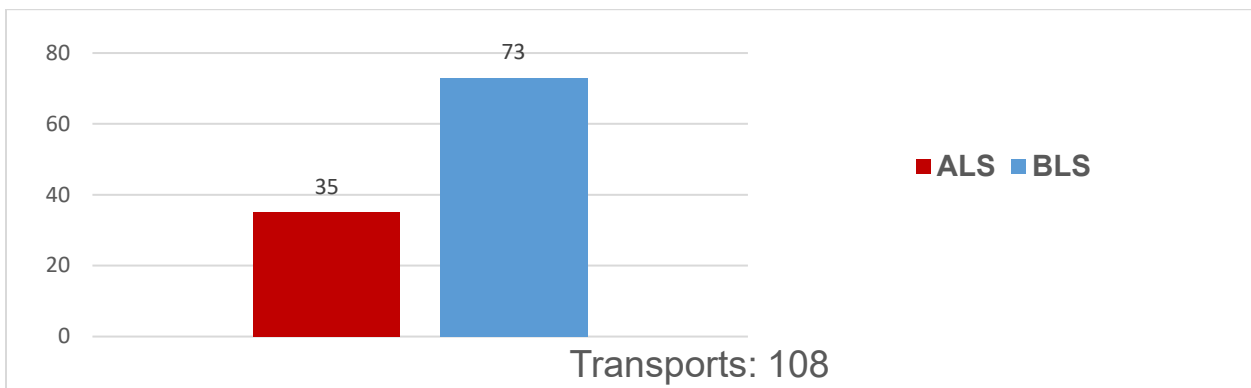


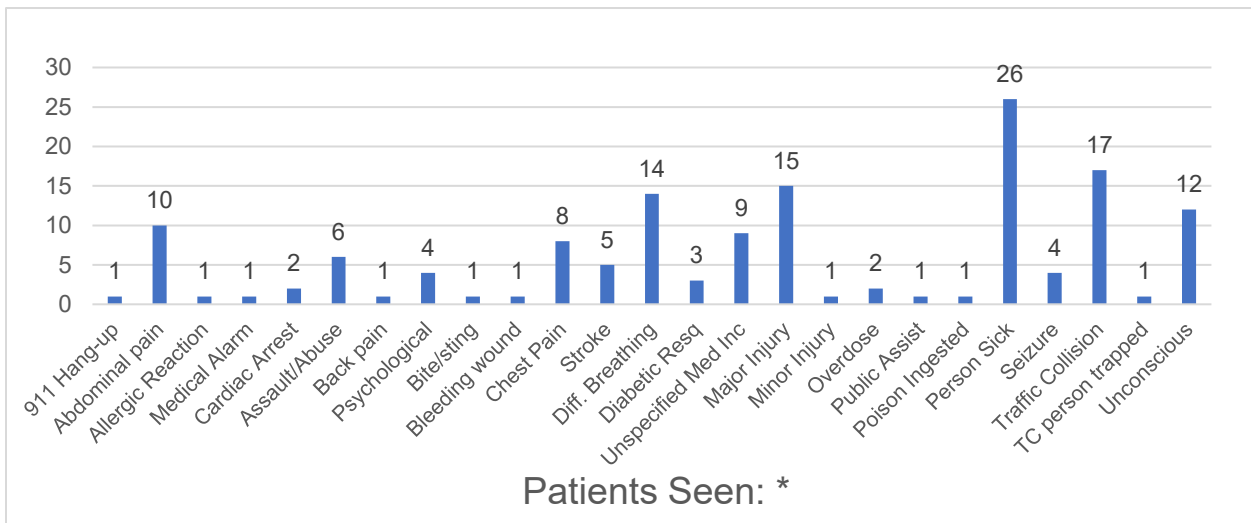

# FIRE ACTIVITY REPORT

## City of Calabasas | March 2022

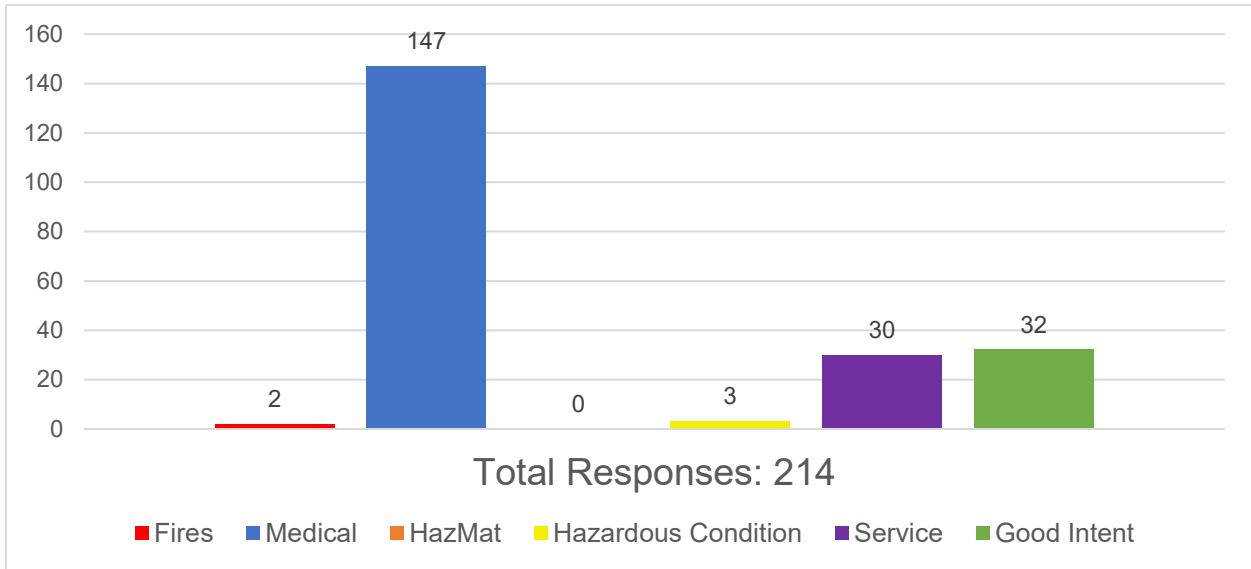

**ALS Transports:** accompanied by paramedic; **BLS Transports:** no paramedic on board

\*Patients Seen total will be higher than Medical Calls total in first graph if there were multiple patients at one incident.



# FIRE ACTIVITY REPORT

City of Calabasas | March 2022

## FIRE INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
03/20/22	Fire, other	24255 DRY CANYON COLD CREEK Rd	Outdoor wood pile used for fireplace. When owner arrived at home, pile of wood was on fire. No signs of outside ignition. Property is gated and well away from the road. Most likely cause was spontaneous combustion. Piles of old vegetation within the piles of wood. No structural damage, but Fire was within two feet of garage.	Property: \$1,000.00 Contents: \$0.00
03/31/22	Fire, other	4191 BON HOMME Rd	Trash can fire that spread to detached AC unit. Outdoor fire only, no damage to house.	Property: \$0.00 Contents: \$9,000.00
			<b>TOTAL:</b>	<b>Property: \$1,000.00</b> <b>Contents: \$9,000.00</b>

## OTHER INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
03/01/22	Haz Cond	3973 CEANOTHUS PI	Overheated motor	
03/11/22	Haz Cond	5525 PARKMOR Rd	Arcing, shorted electrical equipment. Burned electrical wires on house and burned transformer on pole. Established safe area and notified Edison. Extinguished small spot of ornamental vegetation below transformer.	
03/21/22	Haz Cond	3861 POPPYSEED PI	Slow gas leak from stove, shut gas valve and notified RP to call Facility Maintenance for repair prior to use.	